
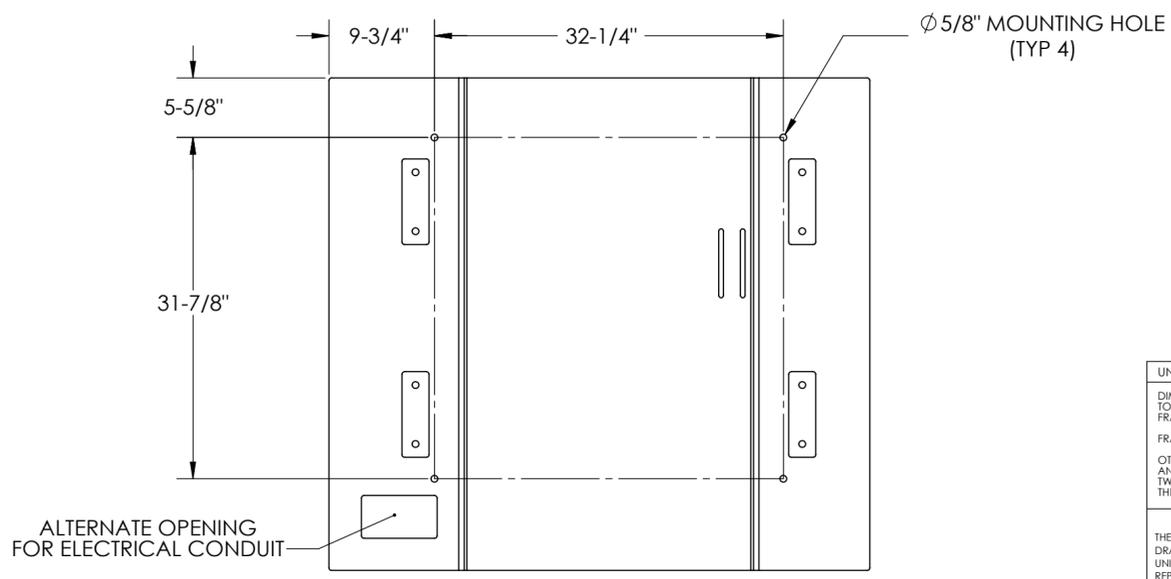
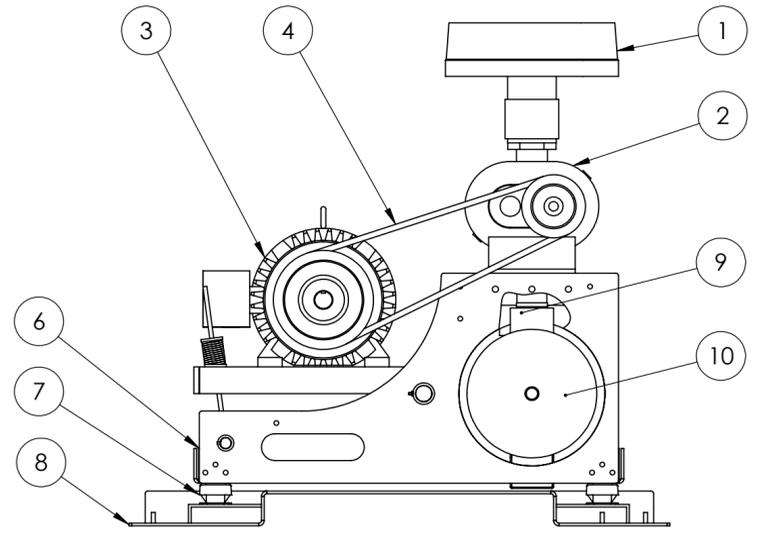
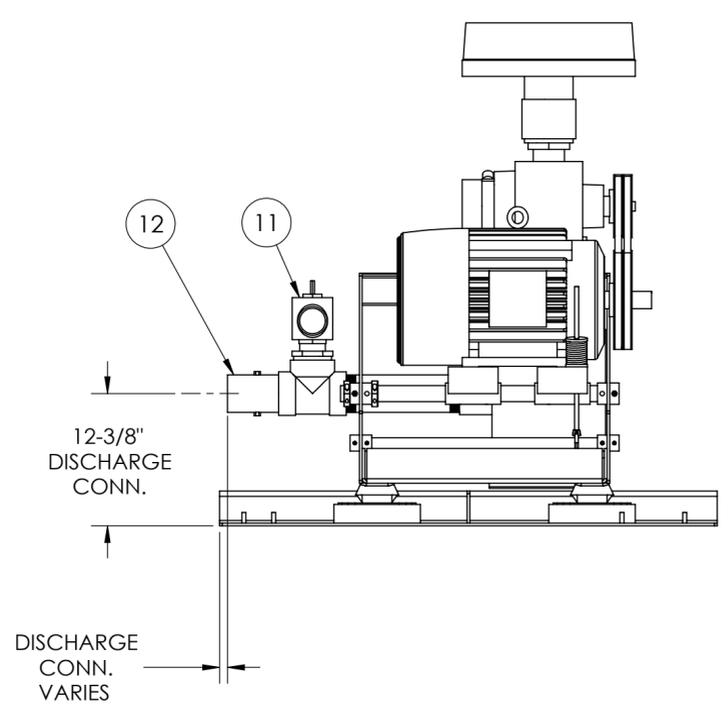
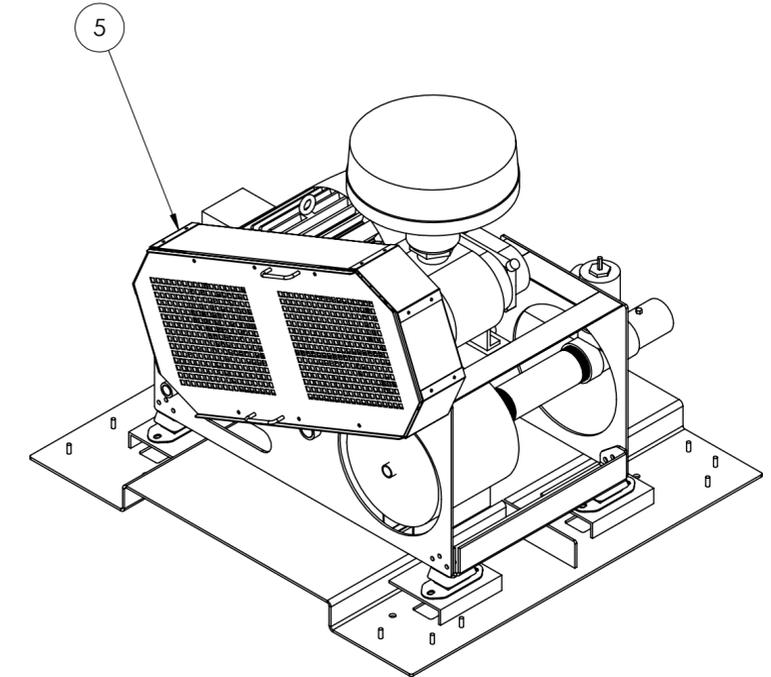


| ITEM NO. | DESCRIPTION | QTY. |
|----------|--|------|
| 1 | Inlet Filter/Silencer | 1 |
| 2 | UBP Blower | 1 |
| 3 | NEMA Motor | 1 |
| 4 | V-Belt Drive Assembly @ 1.4 Service Factor | 1 |
| 5 | 3C2 Belt Guard w/ Easy Access Panel | 1 |
| 6 | 3C2 Blower Base w/ Auto-Tension Motor Base | 1 |
| 7 | Heavy Duty Isolation Mount | 4 |
| 8 | 3C2 Sub-Base | 1 |
| 9 | Discharge Expansion Joint | 1 |
| 10 | Compact Discharge Silencer | 1 |
| 11 | Spring Loaded PRV | 1 |
| 12 | Discharge Check Valve | 1 |
| 13 | 3C2 Acoustical Enclosure | 1 |
| 14 | Inlet Filter Vacuum Gauge | 1 |
| 15 | Discharge Pressure Gauge | 1 |
| 16 | Discharge Thermometer | 1 |

NOTE:

- ITEMS 13-16 ARE OPTIONAL AND SHOWN ON NEXT SHEET.
- SEE PROJECT-SPECIFIC SUBMITTAL FOR COMPONENT MODEL NUMBERS, UNIT WEIGHT, AND OPTIONAL COMPONENTS NOT SHOWN HERE.

| REVISIONS | | | | |
|-----------|------|------------------------------|-----------|----------|
| ZONE | REV. | DESCRIPTION | DATE | APPROVED |
| | A | DRAWING CREATED | 9/7/2010 | BD |
| | B | ENCLOSURE REVISIONS | 3/26/2011 | BD |
| | C | BASE AND ENCLOSURE REVISIONS | 8/10/2011 | BD |

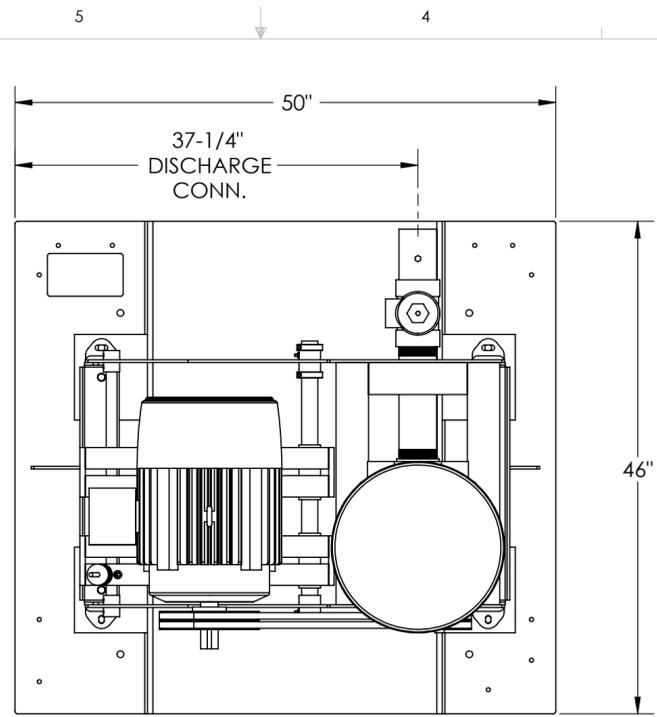

NOTE:






- INSTALL AND OPERATE ACCORDING TO O&M MANUAL.
- DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE.

| | | | | |
|--|--|---|-----------|---|
| UNLESS OTHERWISE SPECIFIED: | | NAME | DATE | UNIVERSAL BLOWER PAC, INC. 440 PARK 32 WEST DRIVE NOBLESVILLE, IN 46060-9252 PHONE: 317-773-7256 www.universalblowerpac.com |
| DIMENSIONS ARE IN INCHES | | DRAWN | BD 9/7/10 | |
| TOLERANCES: | | CHECKED | | TITLE: 3C-Pac Size 2 |
| FRACTIONAL TO USER CONNECTIONS: ±1" | | ENG APPR. | | |
| FRACTIONAL TO MOUNTING LOCATIONS: 1/4" | | MATERIAL | | SIZE DWG. NO. 3C2 |
| OTHER FRACTIONAL: ±1 | | STOCK SIZE | | |
| ANGULAR: MACH±0.5 BEND ±2 | | FINISH | | SCALE: 1:12 SHEET 1 OF 2 |
| TWO PLACE DECIMAL ±0.05 | | DO NOT SCALE DRAWING | | |
| THREE PLACE DECIMAL ±0.005 | | PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF UNIVERSAL BLOWER PAC, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF UNIVERSAL BLOWER PAC, INC. IS PROHIBITED. | | |

ENCLOSURE NOTES:

1. CONSTRUCTED OF POWDER COATED ALUMINUM AND STEEL
2. LINED WITH 2" ACOUSTICAL FOAM
3. QTY (2) REMOVABLE PANELS (1 FRONT, 1 REAR)
4. QTY (3) LOCKING COMPRESSION LATCHES TOTAL
5. QTY (1) SUPPLEMENTARY ACCESS PANEL (LEFT SIDE)
6. QTY (1) ELECTRICAL EXHAUST FAN (~1A @ 1/60/120V)
7. INTERNAL JUNCTION BOX PROVIDED FOR EXHAUST FAN AND OPTIONAL SWITCHES
8. CONDUIT OPENINGS PROVIDED FOR FAN AND BLOWER MOTOR (INTERNAL WIRING TO FAN AND MOTOR JUNCTION BOXES BY OTHERS)
9. FORK SLOT COVERS PROVIDED FOR USE AFTER INSTALLATION
10. SEE PROJECT-SPECIFIC SUBMITTAL FOR OPTIONAL COMPONENTS

| REVISIONS | | | | |
|-----------|------|-------------|------|----------|
| ZONE | REV. | DESCRIPTION | DATE | APPROVED |
| - | - | See Sheet1 | - | - |

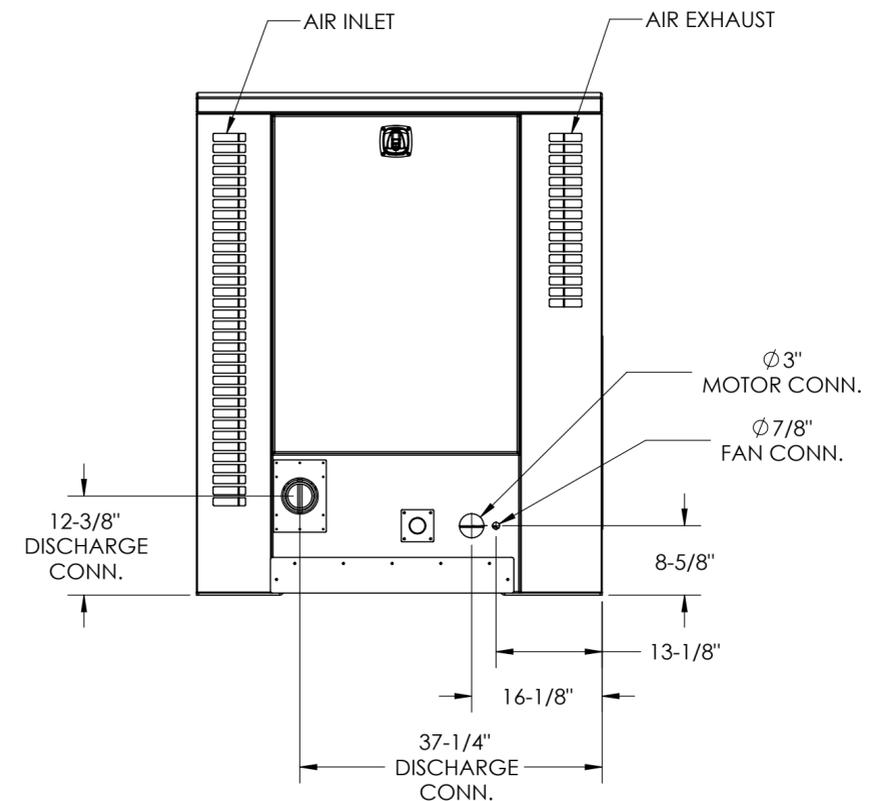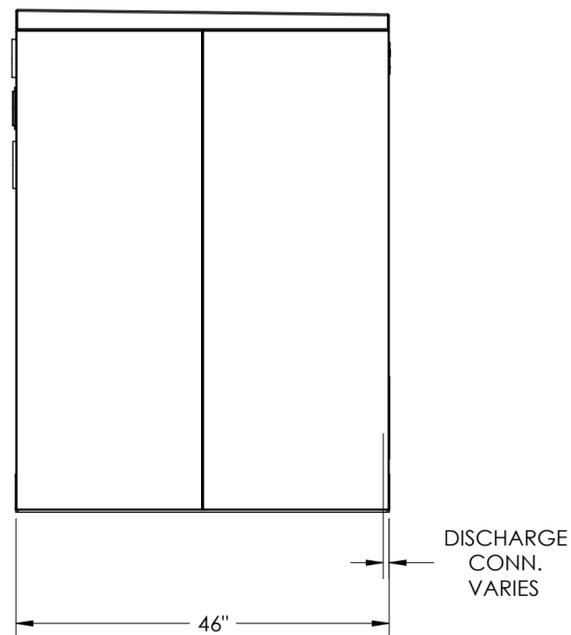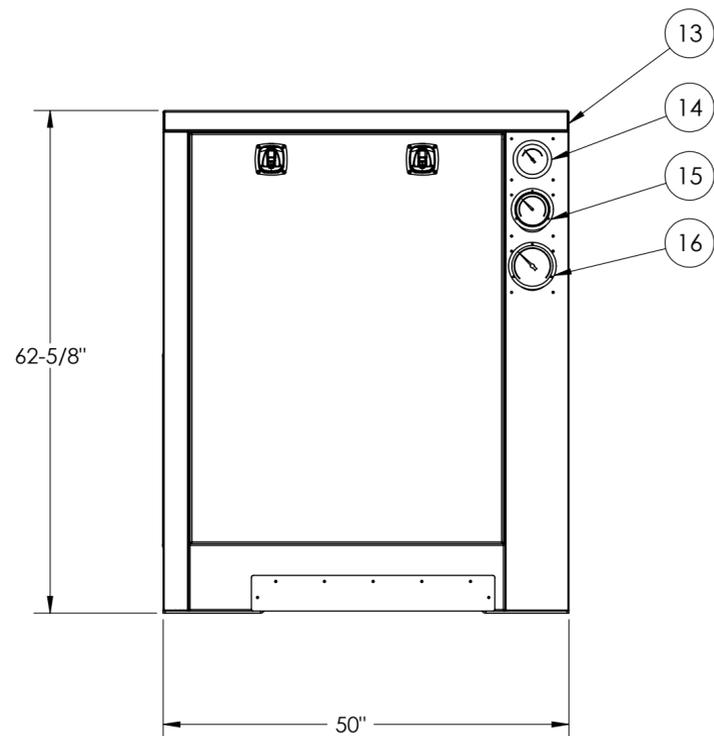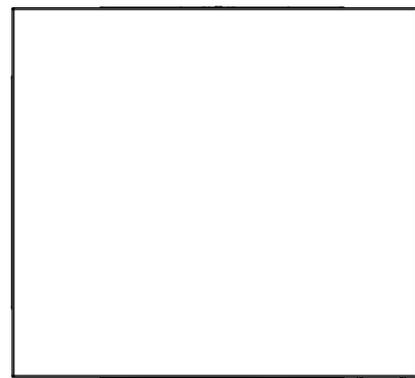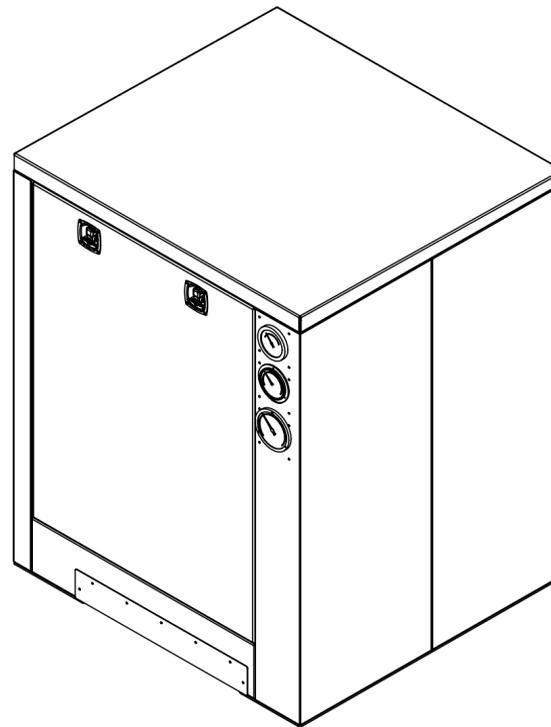

NOTE:

1. INSTALL AND OPERATE ACCORDING TO O&M MANUAL.
2. DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE.

| | | | | |
|--|--|----------------------|-----------|---|
| UNLESS OTHERWISE SPECIFIED: | | NAME | DATE |  UNIVERSAL BLOWER PAC, INC. 440 PARK 32 WEST DRIVE NOBLESVILLE, IN 46060-9252 PHONE: 317-773-7256 www.universalblowerpac.com |
| DIMENSIONS ARE IN INCHES | | DRAWN | BD 9/7/10 | |
| TOLERANCES: | | CHECKED | | |
| FRACTIONAL TO USER CONNECTIONS: ±1" | | ENG APPR. | | |
| FRACTIONAL TO MOUNTING LOCATIONS: 1/4" | | MATERIAL | | TITLE: 3C-Pac Size 2 |
| OTHER FRACTIONAL: ±1 | | STOCK SIZE | | SIZE DWG. NO. C 3C2 |
| ANGULAR: MACH ±0.5 BEND ±2 | | FINISH | | SCALE: 1:10 SHEET 2 OF 2 |
| TWO PLACE DECIMAL ±0.05 | | DO NOT SCALE DRAWING | | |
| THREE PLACE DECIMAL ±0.005 | | | | |